


DRAWING NOT TO BE USED FOR CONSTRUCTION

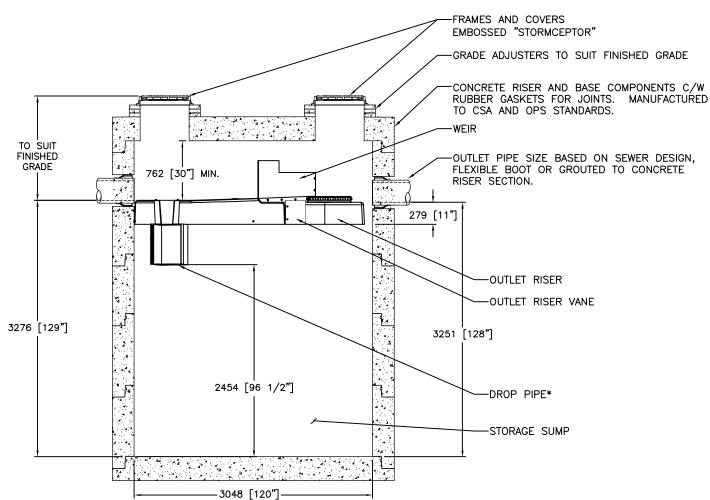

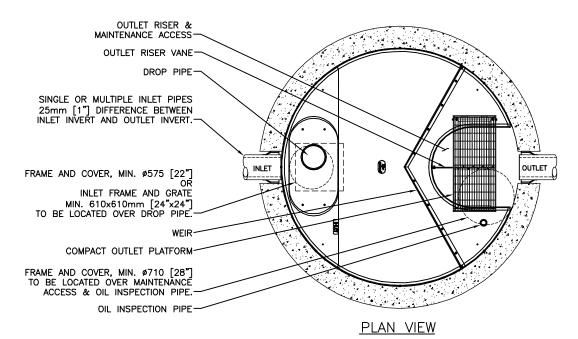

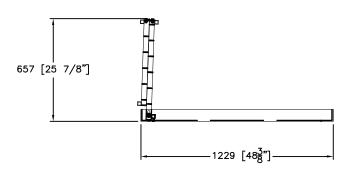

PLATFORM SECTION VIEW (OPEN)

GENERAL NOTES:

* MAXIMUM SURFACE LOADING RATE (SLR) INTO LOWER CHAMBER THROUGH DROP PIPE IS 1135 L/min/m² (27.9 gpm/ft²) FOR STORMCEPTOR EF10 AND 535 L/min/m² (13.1 gpm/ft²) FOR STORMCEPTOR EF010 (OIL CAPTURE CONFIGURATION).

SECTION VIEW

- ALL DIMENSIONS INDICATED ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.
- STORMCEPTOR STRUCTURE INLET AND OUTLET PIPE SIZE AND ORIENTATION SHOWN FOR INFORMATIONAL PURPOSES ONLY.
- UNLESS OTHERWISE NOTED, BYPASS INFRASTRUCTURE, SUCH AS ALL UPSTREAM DIVERSION STRUCTURES, CONNECTING STRUCTURES, OR PIPE CONDUITS CONNECTING TO COMPLETE THE STORMCEPTOR SYSTEM SHALL BE PROVIDED AND ADDRESSED SEPARATELY.
- DRAWING FOR INFORMATION PURPOSES ONLY. REFER TO ENGINEER'S SITE/UTILITY PLAN FOR STRUCTURE ORIENTATION.
- NO PRODUCT SUBSTITUTIONS SHALL BE ACCEPTED UNLESS SUBMITTED 10 DAYS PRIOR TO PROJECT BID DATE, OR AS DIRECTED BY THE ENGINEER OF

FOR SITE SPECIFIC DRAWINGS PLEASE CONTACT YOUR LOCAL STORMCEPTOR REPRESENTATIVE. SITE SPECIFIC DRAWINGS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME. SOME FIELD REVISIONS TO THE SYSTEM LOCATION OR CONNECTION PIPING MAY BE NECESSARY BASED ON AVAILABLE SPACE OR SITE CONFIGURATION REVISIONS. ELEVATIONS SHOULD BE MAINTAINED EXCEPT WHERE NOTED ON BYPASS STRUCTURE (IF REQUIRED).

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE (LIFTING CLUTCHES PROVIDED)
- C. CONTRACTOR WILL INSTALL AND LEVEL THE STRUCTURE, SEALING THE JOINTS, LINE ENTRY AND EXIT POINTS (NON-SHRINK GROUT WITH APPROVED WATERSTOP OR FLEXIBLE BOOT)
- D. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT THE DEVICE FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- E. DEVICE ACTIVATION, BY CONTRACTOR, SHALL OCCUR ONLY AFTER SITE HAS BEEN STABILIZED AND THE STORMCEPTOR UNIT IS CLEAN AND FREE OF DEBRIS.

STANDARD DETAIL NOT FOR CONSTRUCTION

								N 3A9 N 3A9 116-980-9800 116-980-980 116-980-980 117-980-980 118-980 118-980 11	
SITE SPECIFIC DATA REQUIREMENTS							3	INTL +1- INTL +1- INTL +1- I Auster Pat I I Interess I I I Interess I I I I I I I I I I I I I I I I I I I	
STORMCEPTOR MODEL EF10-C							IMPLIANCE WITH A STATE OF THE S		
STRUCTURE ID						*			
WATER QUALITY FLOW RATE (L/s)						*			
PEAK FLOW RATE (L/s)						*			
RETURN PERIOD OF PEAK FLOW (yrs)						*			
DRAINAGE AREA (HA)						*			
DRAINAGE AREA IMPERVIOUSNESS (%)						*	DATE: 7/17/2018		
PIPE DATA:	I.E.	MAT'L	DIA	SLOPE	%	HGL	DESIGNED:	DRAWN:	
NLET #1	*	*	*	*		*	JSK CHECKED:	JSK APPROVED:	
NLET #2	*	*	*	*		*	BSF	ML	
OUTLET	*	*	*	*		*	PROJECT No.: EF10-C	SEQUENCE No.:	
PER ENGINEER OF RECORD							SHEET:	OF 1	

T

Stormcepto

RECORD.