


Section View A-A

OUTLET PIPE TO BE POSITIONED SUCH THAT OUTSIDE BARREL IS LOCATED WITHIN INDICATED BOUNDARIES

**NOTES:**

1. ALL DIMENSIONS IN MILLIMETERS.
2. WALL THICKNESSES FOR ALL FIBER REINFORCED POLYMER (FRP) VESSEL WALL COMPONENTS VARY FROM 6mm TO 16mm IN ACCORDANCE WITH STRUCTURAL REQUIREMENTS. FRP THICKNESS REQUIREMENTS SHALL BE INDICATED ON PROJECT SHOP DRAWINGS.
3. ALL FRP DOME ELEMENTS CONFORM TO ASME SPECIFICATIONS. SEE SHOP DRAWINGS FOR ADDITIONAL DETAILS.
4. SIZING SHALL CONFORM TO THE MOST RECENT TECHNICAL INFORMATION AVAILABLE FROM IMBRIUM SYSTEMS AT THE TIME OF PROJECT SHOP DRAWINGS.
5. REQUIREMENTS FOR ANTI-BUOYANCY MEASURES SHALL BE DETERMINED BY SPECIFIER TO SUIT SITE CONDITIONS AND IN ACCORDANCE WITH MOST RECENT SPECIFICATIONS AND SHOP DRAWINGS.

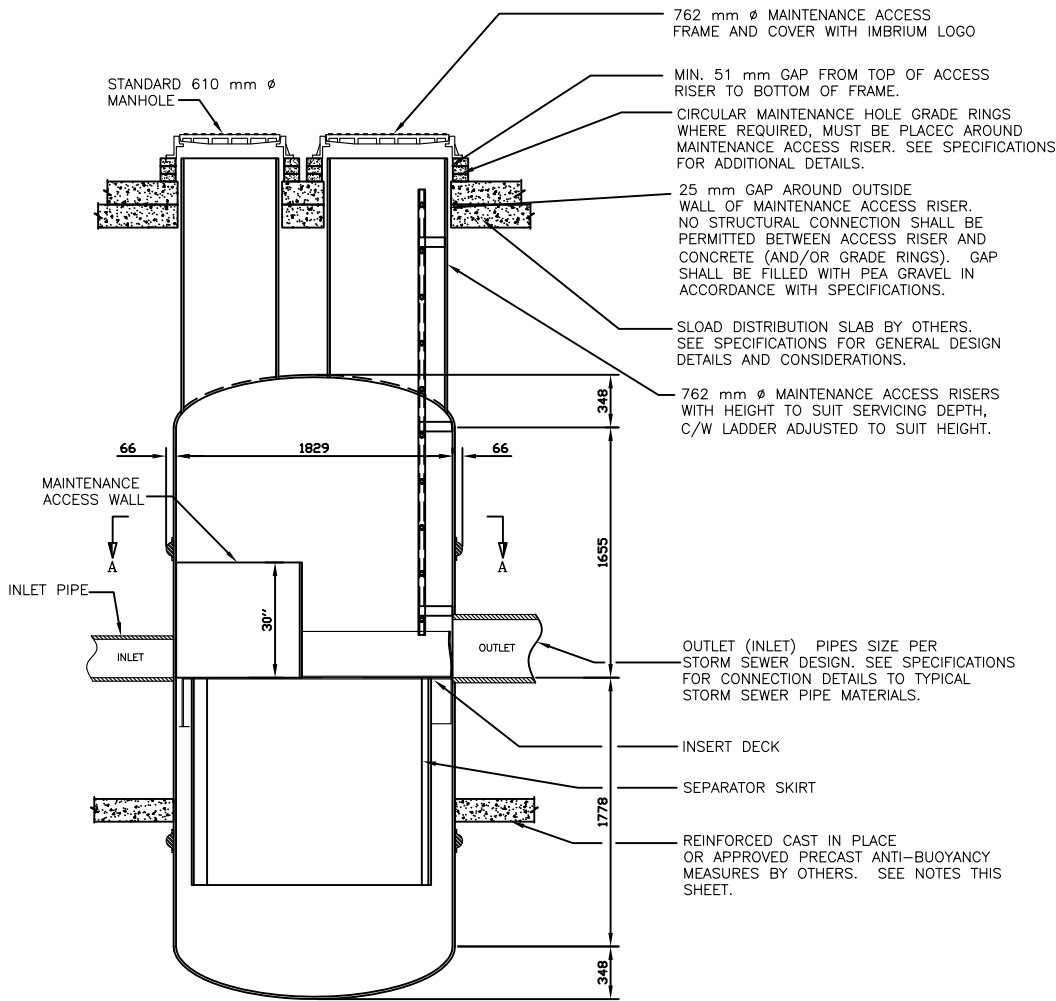

Section View B-B

# DRAWING NOT TO BE USED FOR CONSTRUCTION

THE JELLYFISH SYSTEM IS PROTECTED BY ONE OR MORE OF THE FOLLOWING PATENTS:  
PATENT PENDING

<b>FIBERGLASS JELLYFISH MODEL JF6F</b>	SCALE: 1 : 50								<small>IMBRIUM SYSTEMS INC IMBRIUM INTERNATIONAL LTD www.imbriumsistemas.com Canada: 1-800-565-4801 International: +1-416-960-9900</small>		
								FILE: JF6F.dwg			
	02	11	02	22	LML	BG	REVISED INTERNAL COMPONENTS		DRAWN BY: FM		
	01	09	06	26	FM	SB	INITIAL RELEASE		DATE: JUNE 26, 2009		
	REV	Y	M	D	DRN	CHK	DESCRIPTION		REV.: 01		
									1 OF 1		